



Politecnico  
di Bari

Repository Istituzionale dei Prodotti della Ricerca del Politecnico di Bari

Operational and Tactical Management of Water and Energy Resources in Pressurized Systems:  
Competition at WDSA 2014

This is a post print of the following article

*Original Citation:*

Operational and Tactical Management of Water and Energy Resources in Pressurized Systems: Competition at WDSA 2014 / Giustolisi, Orazio; Berardi, Luigi; Laucelli, Daniele Biagio; Savic, Dragan; Kapelan, Zoran. - In: JOURNAL OF WATER RESOURCES PLANNING AND MANAGEMENT. - ISSN 0733-9496. - 142:5: Special Issue(2016).  
[10.1061/(ASCE)WR.1943-5452.0000583]

*Availability:*

This version is available at <http://hdl.handle.net/11589/58322> since: 2021-03-12

*Published version*

DOI:10.1061/(ASCE)WR.1943-5452.0000583

*Terms of use:*

(Article begins on next page)

# **Operational and Tactical Management of Water and Energy Resources in Pressurized Systems: the competition at WDSA 2014**

O. Giustolisi<sup>a</sup>, L. Berardi<sup>a</sup>, D. Laucelli<sup>a</sup>, D. Savic<sup>b</sup>, Z. Kapelan<sup>b</sup>

<sup>a</sup>*Dept. of Civil Engineering and Architecture Department, Technical University of Bari, Via E. Orabona, 4, 70125 Bari, Italy*

<sup>b</sup>*Centre for Water Systems, College of Engineering, Mathematics and Physical Sciences, University of Exeter, UK*

## **ABSTRACT**

Optimal management of water and energy resources worldwide is a basis for environmental and socio-economic sustainability in urban areas, which has become even more relevant with the advent of the “smart” and “water sensitive” city paradigm. In water distribution networks (WDNs) water resource management is concerned with increased efficiency, which is mainly related to the reduction of leakages, while energy management refers to optimal pump, valve and source scheduling strategies considering the hydraulic system requirements. These management goals require planning of asset renewal and improvement works in the short time (operational) and medium time (tactical) horizons, considering the financial sustainability of relevant actions. The Battle of Background Leakage Assessment for Water Networks (BBLAWN) was designed as a competition held at the 16th Water Distribution Systems Analysis Conference, in Bari (Italy) in 2014 (WDSA 2014), to address the aforementioned management goals. The teams taking part in the BBLAWN were asked to develop a methodology for both reducing real water losses and saving energy in a real WDN considering the possibility of asset renewal and strengthening. Fourteen teams from academia, research centers and industry presented their solutions at a special session of the WDSA 2014 conference. This paper briefly describes the BBLAWN and presents one of the solutions provided by the organizers to illustrate the ideas and challenges embedded in the posed problem. .

The overview of the solutions provided by the participants shows that management decisions need to be supported by engineering judgment as well as with tools that combine computationally effective multi-objective optimization and hydraulic models capable of assessing pressure-dependent background leakages.

## **Keywords**

Water distribution network; Integrated management; Leakages; Energy; Hydraulic models; Pressure Reduction Valves.

## **Introduction**

The series of “Battle Competitions” date back to 1985 with the Battle of the Water Networks (BWN) (Walski et al., 1987), and was created to stimulate academia, research centers and industry to provide solutions and strategies for addressing complex practical problems in water distribution network (WDN) analysis, design and management. More recently the Battle of the Water Sensor Networks (BWSN) (Ostfeld et al., 2008) was held in Cincinnati (OH, USA); the Battle of the Water Calibration Networks (BWCN) (Ostfeld et al., 2012) was held in 2010 in Tucson (AZ, USA); the Battle of the Water Networks Design (BWN-II) (Marchi et al., 2014) was held in 2012 in Adelaide (Australia).

The Battle of Background Leakage Assessment for Water Networks (BBLAWN) was held at the 16th Water Distribution Systems Analysis Conference, in Bari (Italy), in July 2014 (WDSA 2014), thus being the fifth “Battle” on WDNs. The problem was designed to stimulate a discussion about the optimal management of water and energy resources in WDNs. This is actually an emerging issue relevant from environmental and socio-economic perspective worldwide, also pertaining to smart city paradigm.

Optimal management of water resources in WDN actually reflects the minimization of water losses from deteriorated infrastructures and, more explicitly, the background leakages from pipes. These type of distributed losses are less evident than major bursts and usually run for longer before repair (Germanopoulos, 1985). In addition, in aged pipes the joint effect of both increased head losses (due to increased internal roughness) and background leakages causes pressure drop through the system. A commonly adopted countermeasure for this consists of increasing water pumping into the system in order to provide sufficient pressure to deliver water to a service reservoir or directly into distribution. This, in turns, results in increased water losses and energy consumption.

Thus, water and energy management are directly related and depend on WDN operation (e.g. filling/emptying of tanks), pressure regime through the network and the total water demand, including both customers’ water requirements and leakages (Giustolisi and Walski, 2012).

On this premise, minimizing water and energy consumption is a complex problem that, in the short-term horizon, requires effective *operational* strategies, as well as sustainable asset renewal plans for the *tactical* planning (medium term horizon). In fact, the reduction of water leakages in the short time horizon could be achievable by implementing optimal pumping (e.g. Giustolisi et al., 2013) as well as by installing pressure control valves to avoid excessive pressure in some parts of the network. Nonetheless, in real systems there is a range of technical asset management options including pipe renewal (e.g. replacement, relining) or installation of new pipes in parallel to the existing ones, enlargement of existing tanks or enhancement of pumping stations. The selection of the most effective alternative needs to be

evaluated in the medium term horizon, and in conjunction with optimal operation strategies. In addition, each technically feasible solution need to be evaluated in terms of financial sustainability, considering total costs, i.e., both operational (OPEX) and capital (CAPEX) expenditure, in order to be readily evaluated by water utilities.

### **The Battle of Background Leakage Assessment for Water Networks - BBLAWN**

The BBLAWN called for teams from academia and industry to design a methodology for reducing water losses due to background leakages, considering the cost for upgrading the hydraulic system capacity. The intervention options available to the teams were pipe replacement or installation in parallel to existing pipes, installation of new parallel pumps and enlarging tanks, the installation of pressure control valves (PRVs), while considering also the cost of energy and water losses (see Giustolisi et al. (2014) and BBLAWN webpage for further details). The aim was to stimulate competing teams to deal with the conflicting cost objectives (i.e., asset upgrading versus energy cost and leakage reduction versus system pressure reduction using costly control valves).

In order to emphasize the need for reducing leakages not only with the aim of managing the operational costs (that are part of the water tariff for customers), but also for reducing the impact on environmental and economic damages caused by leakages, the problem statement assumes that the utility is also facing an environmental/damage penalty due to water lost, which is fixed at 2 €/m<sup>3</sup>.

The competition used C-Town (Ostfeld et al. 2012) whose network layout is reported in Fig. 1. To solve the BBLAWN problem, it was assumed that the city has already commissioned the development of a calibrated hydraulic model of the existing network to be used in evaluating its present state and future improvements and performance. Therefore, the network model includes the network layout, the demand patterns and the background leakage model parameters. It also contains existing pump and tank characteristics and the controls of pumps and valves based on water level in tanks.

The existing infrastructure is not able to meet the pressure performance target of 20 m at each node with demand, and the situation is compounded by excessive background leakage. Therefore, the water utility is interested in minimizing operational and capital costs.

The (re)design problem must be solved as a one-stage intervention problem (i.e. both operational and capital costs to be minimized are reported as annual cost, which account for the lifetime of the single component and the discount rate), and the teams were asked to come up with a solution respecting other common engineering considerations and operational constraints in order to propose a methodology and

provide one feasible solution from the utility standpoint. For this reason, the solutions were evaluated by the organizers in terms of operational and capital costs, but also accounting for the soundness of the methodology and technical justification for the choices taken by the teams.

In fact, the BBLAWN competition was designed as close as possible to a real situation in terms of complexity and design/operational options. This was aimed at stimulating the discussion and exchange of information among the different teams about the use of optimization tools, the need for enhanced hydraulic modelling to predict the background leakages and the whole system behavior, as will be discussed in the next section.

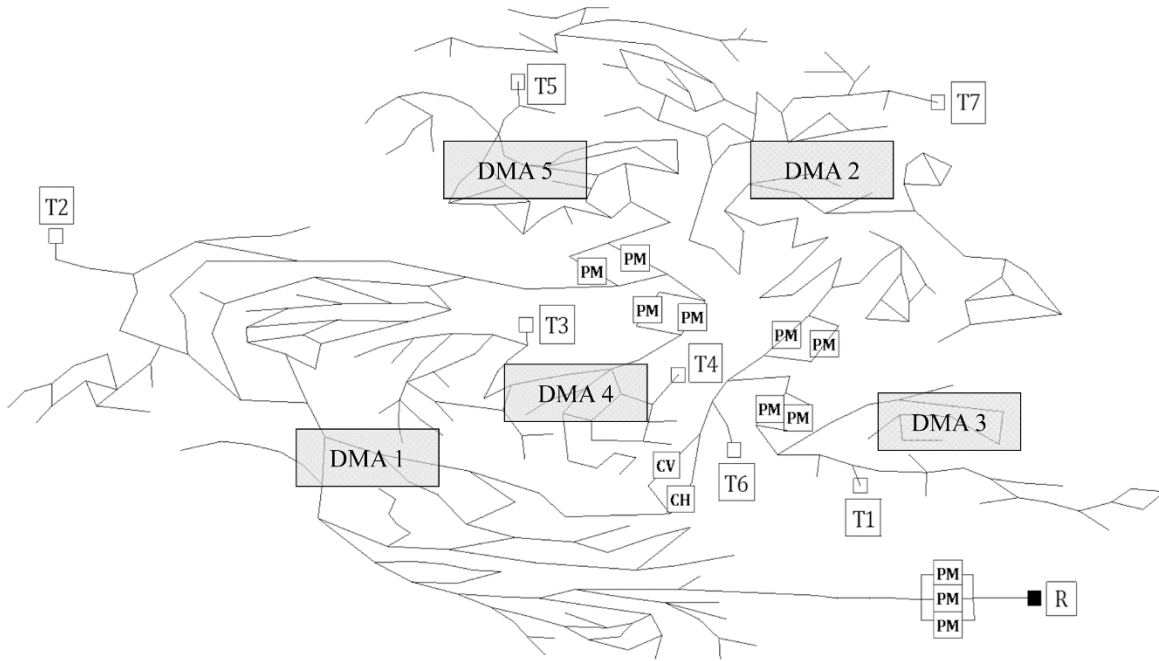


Fig. 1. TOWN-C for BBLAWN composed of 444 pipes, a reservoir (R), seven tanks (Tx), eleven pumps (PM), a control valve (CV), a check valve (CH).

### ***Hydraulic and Leakage Modelling***

Water leakage is caused by small or large breaks and openings in pipes, which occur at water mains and along the pipe connections to properties. The technical literature classifies leakages in background and burst leakage (unreported or reported) depending on the level of outflow. Germanopoulos (1985) proposed the following model for background leakages:

$$d_k^{leaks} (P_{k,mean}) = \begin{cases} \beta_k L_k P_{k,mean}^{\alpha_k} & P_{k,mean} > 0 \\ 0 & P_{k,mean} < 0 \end{cases} \quad (1)$$

where  $k$  = index referring to the  $k$ th pipe;  $P_{k,mean}$  = model mean pressure along the  $k$ th pipe in [m] (see

next section for details);  $d_k^{leaks}$  = background leakages outflow along the  $k$ th pipe in [m<sup>3</sup>/sec];  $\alpha_k$  and  $\beta_k$  = model parameters;  $L_k$  = length of the  $k$ th pipe, in [m].

Background leakages are diffuse (spatially distributed) and low intensity losses (outflows) along pipes (mains and connections), which depend on the asset condition, i.e., as related to the multiplier  $\beta$  in Eq. (1). They run continuously over time and could cause significant losses from the system.

Bursts are the natural evolution of background leakages due to external forces/factors, which act on deteriorated pipes. The model in Eq. (1) is aimed at predicting the outflows of diffuse leakages, considering also unreported small bursts, thus it is useful for planning purposes. This is opposite to burst modelling, which is much more suited for operational purposes, e.g., for outflow location and consequence prediction. Therefore, the competing teams were asked to employ hydraulic modelling considering background leakages (Giustolisi et al., 2008) because the hydraulic consistent prediction of those outflows not only influences the computation of the water losses but also the assessment of the system capacity, energy and water use.

The need for an accurate prediction of the system behavior is important to (re)design an effective solution for real systems. To this purpose, the teams were asked to compute the energy for pumping using the following formulations involving expressions for variable head and efficiency:

$$\begin{aligned}
 H &= H^s - rQ^c \\
 \eta &= -\frac{4\eta_{max}}{Q_{max}^2} Q^2 + \frac{4\eta_{max}}{Q_{max}} Q \\
 Q_{max} &= \left( \frac{H^s}{r} \right)^{\frac{1}{c}}
 \end{aligned} \tag{2}$$

where  $\eta_{max}$  = maximum pump efficiency;  $H^s$ ,  $r$  and  $c$  = parameters of the pumps. Eq. (1) represents a parabolic function with the maximum value ( $\eta_{max}$ ) at  $Q_{max}/2$  (Giustolisi et al., 2013).

### ***Background Leakages versus Burst Modelling***

Background leakage modelling, Eq. (1), for planning purposes is different from modelling a single burst for operational purposes like, for example, for its detection and/or preliminary localization.

The model in Eq. (1) depends on the average pressure in pipes, because leakages along mains and pipe connections are dependent on pressure. Consequently, the average local pressure is a good indicator influencing the total leakage in a pipe. In fact, the model in Eq. (1) states that the overall leakage outflow (the volume of water losses), is proportional to the average, i.e. local, pressure in the hydraulic system

where the exponent  $\alpha$  is related to the pipe material (i.e. stiffness) (Giustolisi et al., 2008). From the hydraulic modelling point of view, it is important to remark that, given the  $k$ -th pipe whose end nodes are  $i$  and  $j$ , the model for background leakages in Eq. (1) is different from the model for pipe bursts (i.e., outflows from nodes). The model in Eq. (1) states that the background leakages for pipe  $k$  are:

$$d_k^{leaks}(P_{k,mean}) = \beta_k L_k \left( \frac{P_i + P_j}{2} \right)^\alpha \quad (3)$$

and, for modelling purpose, such background leakage outflow along the  $k$ th pipe is concentrated at two water withdrawal points at the end nodes, and divided equally:

$$d_i^{leaks}(P_{k,mean}) = d_j^{leaks}(P_{k,mean}) = \frac{\beta_k L_k}{2} \left( \frac{P_i + P_j}{2} \right)^\alpha \quad (4)$$

Lumping the pipe level outflow at the end nodes preserves the mass balance while causes an error in the energy balance equation. The magnitude of the error can be evaluated as in Giustolisi and Todini, (2009) and Giustolisi (2010).

The strategy of using a concentrated outflows at pipe ending nodes characterized by the outflow coefficient  $\beta_k L_k/2$ , (i.e., assuming a burst model surrogating the background leakage model), results in the following computed outflows from nodes  $i$  and  $j$  respectively:

$$d_i^{leaks}(P_i) = \frac{\beta_k L_k}{2} (P_i)^\alpha; \quad d_j^{leaks}(P_j) = \frac{\beta_k L_k}{2} (P_j)^\alpha \quad \Rightarrow \quad (5)$$

$$d_k^{leaks}(P_i, P_j) = \beta_k L_k \frac{(P_i)^\alpha + (P_j)^\alpha}{2}$$

This assumption generates a modelling error, represented by the difference between  $d_k^{leaks}$  of Eq. (5) and Eq. (4), that is actually a function of asset (i.e.  $\alpha, \beta, L$ ) and nodal pressures,

$$\beta_k L_k \left( \frac{P_i + P_j}{2} \right)^\alpha - \beta_k L_k \frac{(P_i)^\alpha + (P_j)^\alpha}{2} = f(\alpha, \beta_k, L_k, |P_i - P_j|) \quad (6)$$

It is worth noting that nodal outflows computed by Eq. (4) and (5) are different even if  $\alpha = 1$  is used:

$$\begin{aligned}
d_i^{leaks} &= \frac{\beta_k L_k}{2} \left( \frac{P_i + P_j}{2} \right) & d_j^{leaks} &= \frac{\beta_k L_k}{2} \left( \frac{P_i + P_j}{2} \right) & \text{background leakage model} \\
d_i^{leaks} &= \frac{\beta_k L_k}{2} P_i & d_j^{leaks} &= \frac{\beta_k L_k}{2} P_j & \text{burst model}
\end{aligned} \tag{7}$$

Indeed, Eqs (4) and (5) return different leakage outflows lumped at nodes causing different pressures through the network, which, in turns, change the background leakage outflows.

In summary, for any  $\alpha \neq 1$ , the difference between the background leakages prediction on a single pipe is evident as reported in Eq. (6), while for  $\alpha = 1$  the predictions become different because the demands and pressure distribution in the network are different.

### Solution of the Competition Organizers

The organizers of the BBLAWN also solved the problem in order to verify its feasibility and provide a further contribution to the discussion. The solution is developed using a mix of engineering judgment, system optimization and extended period simulation (EPS) analysis aimed at supporting the decisions step by step. The solution was designed in three steps that are summarized here and detailed in the following.

Step 1. Pump scheduling optimization of the original hydraulic system is performed first without upgrading any assets. The step is useful for the assessment of the initial level of leakage (assuming optimal pumping) and the hydraulic capacity of the system. The EPS analysis of the optimized system allowed the identification of critical nodes in terms of pressure requirements. Together with the analysis of the hydraulic behavior of the WDN they were used to select candidate pipes for replacement in the comprehensive system optimization of step 2.

Step 2. Hydraulic system optimization is performed considering the cost of: (i) pipe replacement; (ii) tank enlargement; (iii) new installed parallel pumps; (iv) pump scheduling; and (v) water loss reduction. Before optimization runs, some pipes of the WDN were closed at no cost (since in the BBLAWN problem statement an isolation valve is assumed present on each pipe; these pipes are reported as dotted lines in Figure 2). Indeed, closing a pipe allowed all the water feeding a network segment to go through the pipes with a PRV. It was assumed that PRVs are not installed yet in Step 2 but they would be installed in the future with the option of a multi-stage intervention strategy.

Step 3. Pump scheduling optimization is performed by considering 25 PRVs already installed,



and the asset-intervention solution obtained in step 2. The pump scheduling problem was then solved and the 25 PRVs were ranked based on their individual contribution to the reduction of water losses. On the one hand, this strategy permitted to have the total cost of the intervention together with the total expected reduction of energy and water loss costs (as requested by BBLAWN rules). On the other hand, it supports the utility in selecting the most effective sequence of valves to install considering the incoming of budget and the marginal advantage of each installation.

### *Step 1. Optimal pump scheduling of the original hydraulic system*

This stage provided a solution showing a small pressure deficit at two nodes (indicated with empty black circles) in Figure 2, occurring at the first hour of the weekly operational cycle. The volume of water losses during the week was 36,281 m<sup>3</sup>, corresponding to 26.05 % of the total water put into the system, which corresponds to the weekly customer demand of 102,973 m<sup>3</sup>. The weekly energy consumption was 42,221 KWh, corresponding to a cost (given the energy tariff pattern) of 5,176 €. The solution of this stage was helpful for understanding WDN behavior over time (EPS analyses). In addition, it represents the maximum system performances achievable without any asset upgrade, thus being of direct relevance for the water utility.

### *Step 2. Hydraulic system optimization with upgrade of hydraulic capacity and closing pipes*

The engineering judgment and EPS analyses drove the system optimization mainly to upgrade the system hydraulic capacity. To this purpose, the candidate pipes to be replaced were identified as those located along the transmission lines (see blue segments in Figure 2). There are three basic motivations for selecting the main transmission pipes.

1. The hydraulic capacity of the network was reduced by closing some additional pipes (dotted lines in Figure 2) to prepare the system for the installation of PRVs (based on engineering judgment). This affected the ability to deliver water from the pump system of DMA 1 (i.e., close to the reservoir) to the tanks n.2 and n.6 (see Figure 1) and to the four inline pump systems of DMAs 2-5.
2. As it is not hydraulically feasible to reduce the pressure along transmission pipes by installing PRVs, it is better to replace these pipes in order to reduce the volume of water losses. In addition, from system reliability perspective is better to renew transmission pipes whose failure would reduce significantly the hydraulic capacity.

- Interventions on transmission pipes are cost efficient for the utility considering a one-stage intervention. Furthermore, this approach reduced the search space during the optimization stage, which improved in terms of computational efficiency and effectiveness.

Consistently with the choice of increasing the system hydraulic capacity, six new parallel pumps were assumed as candidates for upgrading the pump system of DMA 1 and two for each inline pump systems of DMAs 2-5. Finally, tanks were considered as candidate for enlargement in order to reduce the energy cost (through optimal pumping) and to increase the hydraulic capacity of the DMAs 2-5, where pipes were not replaced, together with the possibility to increase the maximum power of the local pump systems.

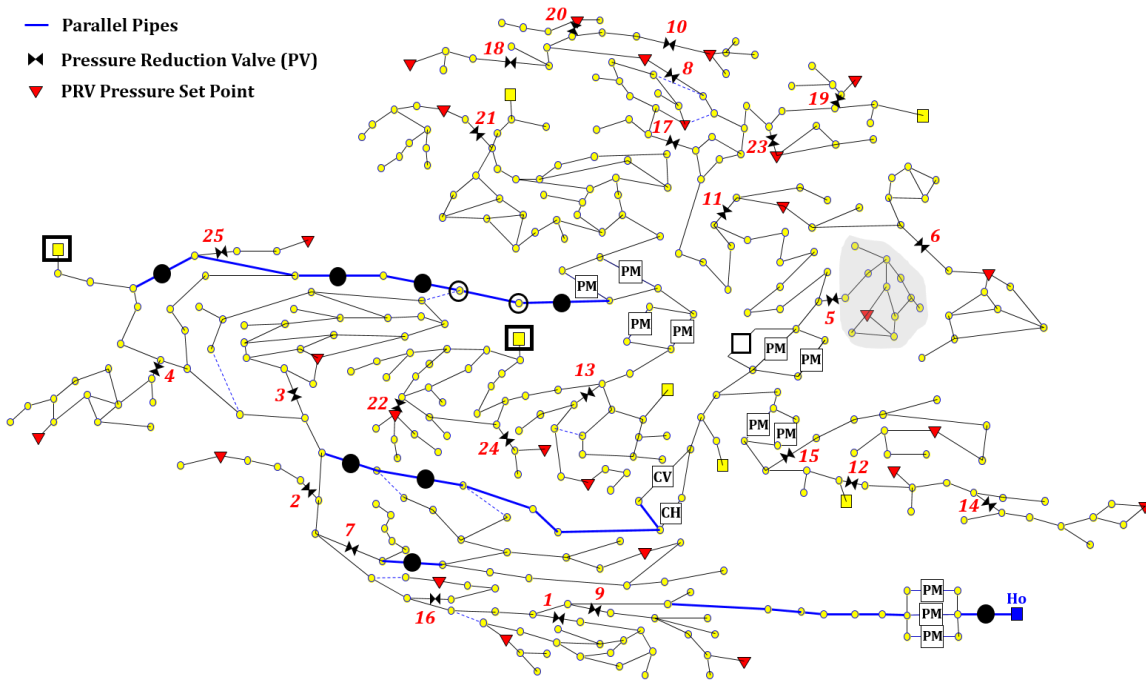


Fig. 2. TOWN-C pressure control valve (PRV) and node of pressure set (Pset).

In summary, the overall approach was to segment the network in order to reduce the pressure locally with 25 PRVs and increase the hydraulic capacity by means of the replacements of DMA 1 transmission pipes. Additionally, upgrading the main pump system (in DMA1) and tank n.2 was also considered. Furthermore, it is possible to increase the local hydraulic capacity of the DMAs 2-5 by upgrading inline pump systems and by enlarging internal tanks.

Figure 3 shows the capital costs of Pareto solutions obtained by the multi-objective optimization

procedure, where separate costs (i.e., pipe and pump cost; energy and water loss cost; and tank enlarging cost) were minimized simultaneously. This was achieved by using a dedicated function available in the WDNNetXL system ([www.hydroinformatics.it](http://www.hydroinformatics.it)). The fifth solution from the left of the Pareto front (see Figure 3) was selected based on engineering judgment. This solution permits the WDN hydraulic capacity to increase by replacing seven pipes and enlarging two tanks, with tank water levels controlling the pumps. This entails cheap asset strengthening works, which could be immediately implemented by the water utility, being also a good starting point for next optimizations. The solutions results in 25.11 % of leakages and required 13,306 € for the replacement of pipes and 44,660 € for the enlargement of tanks T2 and T3 to the maximum volume of 1,693 m<sup>3</sup> and 180 m<sup>3</sup>, respectively.

Figure 2 reports a black solid circle on the seven replaced pipes of the transmission line and a square on the enlarged tanks (i.e. T2 and T3). A pipe was also replaced (based on EPS analysis) in one segment of DMA 1 that was prepared to allocate a PRV (indicated with “7” in Figure 2) (by closing two pipes). Finally, the solution has one new pump (identified with a white square in Figure 2), at the cost of 4,339 €, to be installed for the DMA 2. The total weekly energy consumption for this solutions is 42,164 KWh, corresponding to a cost (given the energy tariff pattern) of 5,074 €.

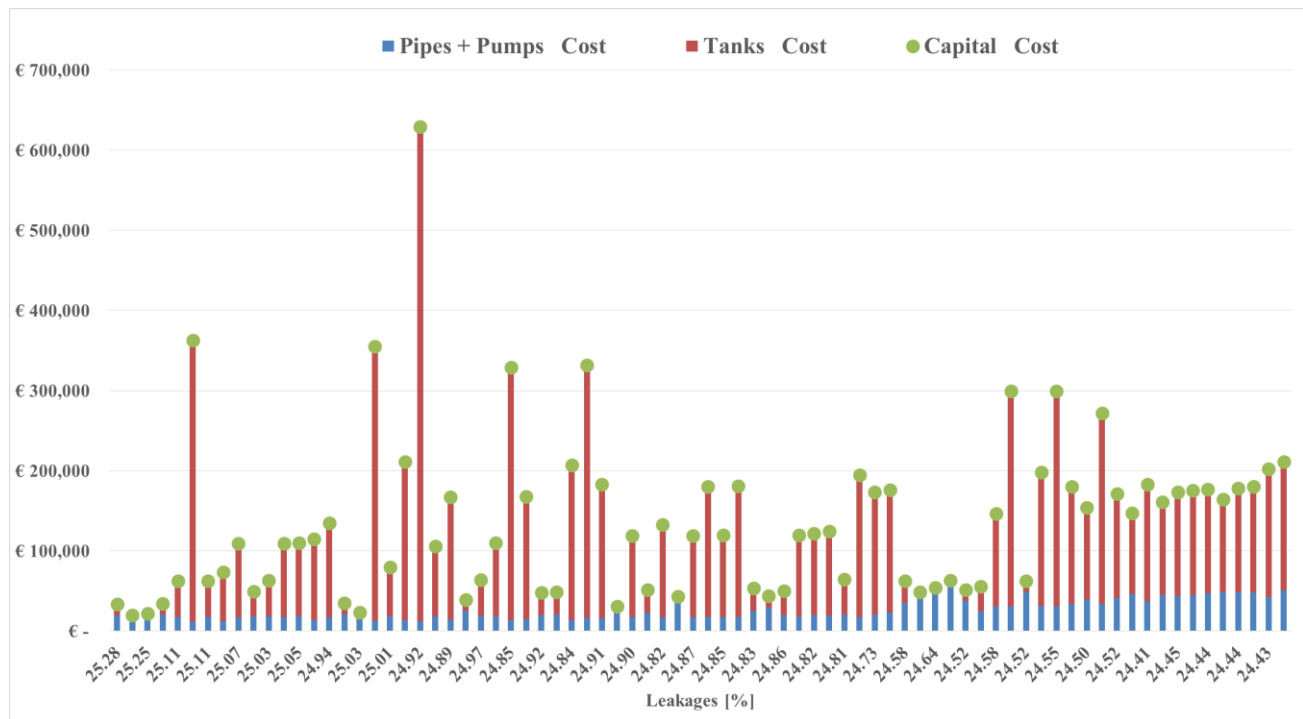


Fig. 3. Pareto front of solutions for the multi-objective optimization problem (pipe and pump cost vs. energy and water loss cost vs. tank enlarging cost)

### Step 3. Pumping optimization considering all the PRVs and ranking of their installation

Once the upgrading of assets was completed, the EPS analysis was performed to locate critical nodes for controlling PRVs. Remotely controlled pressure devices were used and critical nodes were selected based on the elevation and the hydraulic distance from the valves (remote set control points of PRVs are reported as red triangles in Figure 2). The selection of the critical nodes in a DMA (i.e., experiencing minimum pressure) to control PRVs allows setting the pressure at 20 m (minimum pressure for a correct service) which does not change over time (Giustolisi and Walski, 2012). This way the optimal control of the degree of valve opening does not require modulating the pressure based on the node immediately downstream from the PRV, which needs to be predicted by the model based on assumptions about demand variation over time. Of course, such solution requires that the hydraulic model to be used for assessing system performances is capable of simulating remotely controlled PRVs.

Furthermore, the pressure in the segment with no demand (see shadowed area in Figure 2) was kept low by setting it at 2 m at the critical node (i.e. as per BBLAWN rules). The pumping schedules with the setting of 25 PRVs was then optimized achieving a solution with the 18.60% of leakages (23,531 m<sup>3</sup> of water loss) and 37,430 KWh of energy consumption corresponding to a reduced cost of 4,438 €.

The above optimal pumping schedule was set and the EPS analysis was performed assuming the installation of one PRV at a time. The 25 PRVs were ranked in descending order based on leakage of reduction achievable by installing each PRVs. This was followed by analyzing the cumulative effect of the sequential installation of 25 PRVs. Table 1 reports the results in terms of weekly water losses, percentage of leakages and energy consumption.

Table 1. Ranking of the PRVs

Pipe ID	Pipe ID of PRV	Water Lost [m <sup>3</sup> ]	Leakage [%]	Energy [KWh]
	original	36,281	26.05	42,221
	solution 5	34,533	25.11	42,063
P122	48	32,140	23.79	41,315
P758	276	30,639	22.93	40,870
P789	299	29,458	22.24	40,365
P5	234	28,637	21.76	39,849
P305	163	27,976	21.36	39,346
P1000	441	27,395	21.01	39,379
P115	40	26,807	20.66	39,202
P1033	20	26,342	20.37	38,956
P125	51	26,049	20.19	38,898

P1002	443	25,794	20.03	38,679
P937	368	25,575	19.90	38,628
P786	296	25,240	19.69	38,548
P16	79	24,943	19.50	38,539
P772	286	24,801	19.41	38,418
P794	301	24,580	19.27	38,401
P72	267	24,370	19.,14	38,365
P344	187	24,170	19.01	38,106
P1001	442	24,075	18.95	38,004
P329	175	23,915	18.85	37,668
P1042	28	23,852	18.81	37,667
P633	255	23,823	18.79	37,695
P781	292	23,696	18.71	37,490
P1024	10	23,632	18.67	37,489
P811	316	23,583	18.63	37,474
P10	2	23,531	18.60	37,430

Table 1 could be used as a multi-stage intervention support system allowing the user to assess the residual water losses and energy reduction. It is possible to optimize pumping for each new installation as the control of pumps by tank levels is robust with respect to small variations of demand and/or leakages (Giustolisi et. al, 2014). Finally, Table 2 summarizes the relevant data considering the original and the optimized solutions.

Table 2. Relevant data of the initial and final status of the network. Operational costs are weekly-based.

Solution	Water Loss [m <sup>3</sup> ]	Leakages [%]	Energy [KWh]	Operational cost [€]	Capital cost [€]	PRVs Cost [€]
initial	36,281	26.05	42,221	77,738	0	0
Final	23,531	18.60	37,430	51,500	62,305	26,182

The solution obtained by organizers has an annualized capital cost of 62,305 € + 26,182 € (i.e. for the investment upgrading the asset and for the installation of PRVs), while the reduction of the weekly-based operational costs with respect to the initial condition is about 26,000 € (although that cost is not merely based on economic evaluations regarding the water losses but also financial consideration, as it accounts for the savings achievable as PRVs are progressively installed). If the cost of the lost water was assumed to be 0.5 €/m<sup>3</sup>, the reduction in the weekly operational costs is about 7,000 €, which becomes about 37,000 € when calculating it on annual basis to be compared with the investment. Therefore, the leakage reduction could be less significant if the environmental value of water losses is not considered. However, leakages are indicators of general deterioration and pressure in the system. Therefore, the economic

impact of unplanned interventions caused by the natural progress of deterioration, should be considered when performing a cost-benefit evaluation of the reduction of water losses.

### **Brief presentation of methodologies proposed by the participant teams**

Fourteen teams from academia, research centers and companies provided their solutions for the BBLWAN at WDSA 2014. Here they are briefly presented in the order they were submitted to the conference website; thus such order does not reflect any judgment on the methodologies. Further details on the single approaches and solutions are reported in individual papers authored by each competing team.

Morley and Tricarico (2014) presented a methodology based mainly on the use of population-based optimization algorithm. They formulated the problem as a constrained single and multiple-objective optimization, implementing a generic hydraulic optimization and benchmarking software application (Acquamark). To permit multiple solutions to be executed and evaluated in parallel a distributed computing architecture was implemented. A pressure-driven demand extension to the EPANET2 (Rossman, 2000) hydraulic model is employed to assist the optimization techniques in accurately ranking near-feasible solutions and to dynamically allocate leakage demand to the end nodes of each pipe.

Roshani and Fillion (2014) presented a methodology based on a multi-objective optimization approach to minimize capital and operational costs of the network, employing NSGA-II (Deb et al., 2002). The optimization includes all the decision variables involved, e.g., pipes, valves, pumps and tanks, subject to pressure and water level in tanks constraints. The EPANET2 network solver is used to evaluate pipe leakages (simulated as pressure-dependent by means of the orifice discharge coefficient reflecting the leakage model coefficient in Eq. (3)), as well as to evaluate the hydraulic constraints (i.e., nodal pressures, tank levels, etc.). The C# programming language was used to couple the EPANET2 network solver with the NSGA-II engine. Multi-threading (parallel processing) was used to reduce the computational time.

Iglesias-Rey et al. (2014) presented a methodology combining the use of engineering judgment and an optimization model based on a pseudo-genetic algorithm. The methodology consists of two stages: an analysis of marginal costs of pipes considered for replacement, followed by the network topological analysis to study the pipes that could be potentially closed in order to facilitate pressure control. Additionally, a methodology for studying branched areas was also developed, determining possible location for pressure reducing valves. This approach was aimed at reducing the number of decision variables, thus reducing the domain of the specific optimization model in the second stage. Network hydraulic analysis has been performed using the EPANET2 network solver using emitters at nodes to

simulate leakages.

Creaco et al. (2014) proposed a multi-objective optimization approach considering three objective functions (i.e., minimization of installation cost, operational cost and PRVs cost). The approach consists of four steps. First, some feasible solutions are identified based on engineering judgment. Then, for step two and three, the NSGAI optimizer was implemented to find an optimal set of solutions: firstly considering only to capital and operational costs, and then considering operational and pressure reducing valves costs. Finally, by grouping the solutions found at the end of previous optimization steps the final three-objective Pareto surface was derived and the best solution selected. The methodology implements the EPANET2 hydraulic solver simulating leakages with emitters first, and then assessing leakages using a sub-routine that applied the Germanopoulos' formula.

Price and Ostfeld (2014) proposed a methodology based on the successive Linear Programming by minimizing costs. A linear representation was solved successively for the non-linear constraints of headloss, leakage, pump energy consumption and pipe sizing. The optimization model returned minimal cost pump scheduling and pipe sizing while minimizing leakage and maintaining minimum service pressures to the consumers. The problem is divided into four main parts: PRV positioning, pumping station and water tank sizing, pipe sizing and pump scheduling for minimum leakage and operational cost. The resulting optimal pump scheduling was not controlled by the water levels in the tanks (as required by the main BBLAWN rules) as the pumps are operated to maintain minimum water pressures at the consumer nodes while utilizing minimum electrical tariff periods. For this reason the solution provided was not accepted for the competition since it was not comparable with other teams that complied with the rules.

Diao et al. (2014) proposed a methodology based on a clustering-based hierarchical decomposition. The network is decomposed into a twin-hierarchy pipeline structure consisting of backbone mains and community feeders. The method consists of three steps: clustering analysis; vulnerability analysis; and identification of backbone mains and community feeders. The system was topologically decomposed into backbone mains and 28 communities. Optimal pressure control strategies for each cluster is addressed in a sequential manner based on the cluster hierarchy with constraints on network performance. Considering such simplified topology, the most cost effective PRV placement strategy and pipe upgrading options for each branch cluster were identified.

Eck et al. (2014) proposed a methodology that decomposes the problem according to the type of intervention, considering each type separately, consisting of a sequential assessment of intervention types. Initially, a diagnosis of the network is performed through simulating its hydraulic behavior with

no infrastructure or operational modifications. An optimization technique is then developed to recommend improvements of a particular type, such as pipes to replace. The presented technique is applied sequentially to yield a list of suggested improvements for the network. The leakage simulation problem was transformed into an equivalent formulation for which EPANET can be applied. To simulate the leakage equations, an iterative technique was developed using the emitters feature in EPANET.

Tolson and Khedr (2014) propose to rely on engineering judgment with limited use of optimization to generate an approximation of the Pareto-optimal front without intensive computational requirements. A simple heuristic approach consisting of a five-stage approach based on enumeration and trial-and-error (WDN modeler expert judgment) was used to identify and prioritize potential decision variables (i.e., pipe replication, PRV installation, tank installation, etc.). The decision variables are ranked based on their operational savings per unit of capital cost expenditures with those variables with the highest ratio being implemented. The system hydraulics and objective functions were recalculated after each successive change to ensure feasibility and all intermediate solutions were used to generate a trade-off curve. Finally, the quality of the Pareto-optimal curve generated using engineering judgment, was compared to one created using a heuristic global search optimization algorithm. A background leakage modelling methodology in EPANET was adopted for approximating the leak assessment methodology provided by the competition organizers.

Saldarriaga et al. (2014) presented a methodology that used the Unit Headloss to select pipes to rehabilitate, the Flow-Pressure concept to locate valves and GA for the pump optimization process. The methodology is composed of different steps, starting from the application of a leakage model to the initial network using EPANET model with emitters. The network was then sectorized according to DMA's demand patterns and a rehabilitation process was conducted to meet pressure requirements. An infrastructure optimization process was carried on allowing for improvements, such as installation of new pipes, pumps and tanks, and a pump optimization was iteratively performed together with the estimation of leakage parameters. Finally, the whole network improvement was considered to evaluate the final cost of the proposed solution.

Matos et al. (2014) proposed an evolutionary approach that operates in an exclusively discrete solution space and is intended to require as little engineering judgment and time as possible while attaining acceptable and informative results that are useful for decision-making. Its main features are custom crossover and mutation operators, being the latter guided by specific network and simulation parameters. The developed operators, specific for water distribution network optimization tasks, are applicable to single- and multiple-objective genetic algorithms as well as to other evolutionary algorithms.



Thus, authors presented two implementations: the first consisted of a single-objective (i.e., minimization of the total operational and capital cost) genetic algorithm whose mutation operator was designed to find increasingly parsimonious solutions as the optimization unfolds. The second was a multiple-objective approach: the objectives were the minimization of investment and operational costs. A simple post-processing greedy algorithm to locally refine pipe replacements is also presented as a means of complementing the evolutionary approach.

Computations have been carried out in a Java version of EPANET aiming at increased computational efficiency, greater platform portability, and improved flexibility regarding optimization software.

Rahmani and Behzadian (2014) presented a methodology based on a three-stage multi-objective optimization model. At the first stage, the optimal design of pipeline rehabilitation, pump scheduling and tank sizing is formulated and solved on the skeletonized network by optimizing the costs of pipes, upgrading of pumps and tank and the cost of water losses and energy. The second stage employs the best Pareto front obtained from the first stage to solve the previous two objectives optimization problem for the full network. The third step employs a three-objective optimization model by adding the number of PRVs as the third objective and PRV settings are also added to the decision variables. This stage employs three solutions on the Pareto front of the second stage to seed the optimization on the full network.

The optimization model used in all stages is non-dominated sorting genetic algorithm (NSGA-II) and the simulation model is the EPANET software tool.

Sousa et al. (2014) proposed two optimization models supported by engineering judgment to help in choosing the best strategies to follow, starting with the optimization of the pump controls, followed by the installation of PRVs and the replacement of existing pipes. The first optimization model used is a least-cost design model to identify the pipes to be replaced and size them; the second is an optimal operation model to define the pump controls and the PRV settings. Both models are solved by linking a commercial hydraulic simulation model (a pressure driven EPANET extension) with a simulated annealing algorithm. The selection of final optimal solutions was done using engineering judgment.

Vassiljev et al. (2014) proposed an approach based on a trial-and-error methodology using heuristic methods coupled with hydraulic simulation. To find the optimal solution, customized research tools were developed for WDN optimization. These tools, based on the EPANET2 toolkit, were employed for the optimization of water tanks levels to switch pumps on/off; the estimation of the influence of PRVs on leakages to decide adding a PRV to a pipe or not; the calculation of leakages under different conditions. Commercially available tools are also used carrying out comparison of various network structures (parallel pipe alternatives). The analyses were carried out in four major stages: (a) the elimination of

bottlenecks (in terms of small pipe diameter and/or low pipe roughness coefficient  $C$ ); (b) the installation of PRVs to reduce the pressure at leak nodes; (c) the examination of pump efficiencies; and (d) the optimization of water levels in tanks.

Finally, Shafiee et al. (2014) implemented a genetic algorithm approach within a high-performance computing platform to select tank sizes, pump placement and operations, placement of pressure control valves, and pipe diameters for replacing pipes. Multiple problem formulations are solved that use alternative objective functions and allow varying degrees of freedom in the decision space. The original framework is based on a genetic algorithm that was written in Java and calls functions from the EPANET toolkit to simulate network hydraulics. The framework is implemented on a parallel cluster and was modified for the BBLAWN application, incorporating additional functions from the EPANET toolkit for manipulating pressure control valves and created new functions for calculating hydraulics based on leakage across pipes.

...

## **Discussion**

All the approaches proposed by teams brought interesting contributions to solving the complex BBLAWN problem. The proposed strategies range from those strongly based on a multi-objective optimization including all the conflicting cost objectives and the involved decision variables (pipes, valves, pumps and tanks) proposed by the organizers (Morley and Tricarico, 2014; Roshani and Filion, 2014), to the approaches based on successive stages in which the engineering judgment has the main role, thus resulting in a limited use of optimization procedures (Tolson and Khedr, 2014).

Most of the proposed methodologies are structured as multi-stage approaches combining it with the use of engineering judgment/expertise, which has been aimed at reducing the size of the optimization problem and driving towards the selection of intermediate and final solutions. The use of engineering judgment is very important for the extension of the proposed approaches to real-network problems, because it allows the inclusion of other types of knowledge and expertise in the technical and decision-making process.

From the optimization standpoint, most of the teams implemented population based techniques (i.e., genetic algorithms) in a multi-objective setting, including, in different combinations, the conflicting cost objectives proposed by the organizers. The only exceptions are Price and Ostfeld (2014), who solved the

problem using Linear Programming, and the approach by Sousa et al. (2014) that implemented a simulated annealing algorithm. Some other teams, Diao et al. (2014), Saldarriaga et al. (2014), Rahmani and Behzadian, (2014), tried to reduce the space of solutions of the “main” multi-objective optimization by means of network clustering/sectorisation/skeletonization, thus dealing with a larger number of smaller (and simpler) optimization problems.

From the computational point of view, all teams used the EPANET hydraulic solver with some of them implemented a pressure-driven version in order to enhance the simulation of background leakages. Interestingly, Matos et al. (2014) implemented a Java version of EPANET. Some teams, Morley and Tricarico (2014), Roshani and Fillion (2014), Shafiee et al. (2014), have also made use of parallel processing in order to reduce the computational time of their applications.

As reported by many teams, the adoption of the EPANET2 model, although well-known and used worldwide, showed major limitations in dealing with the BBLAWN real problem. First, it required some modifications/post-processing of results in order to consistently assess the background leakages from pipes according to Eq. (3); otherwise the simulation is affected by errors as explained above. Second, EPANET2 does not model pressure reduction valves controlled by remote set points (i.e., far from the downstream PRV node). This limitation actually prevented all teams from using the remote control option of valve that was allowed in BBLAWN rules. However, this is a preferred option due to control solutions currently available to water utilities. Using remote controlled PRVs is likely to provide solutions that are technically more reliable than “classical” PRVs. In fact the pressure at remote set point (e.g., the critical node in the controlled area) better reflects the real network hydraulic behavior than the one immediately downstream of the PRV. Vice versa, the set point of a “classical” PRV needs to be modulated over time based on some prediction of network hydraulic behavior, which relies heavily on predicted demands and model calibration (and related uncertainties).

In this regard, the solution proposed by Price and Ostfeld (2015) suggested that a more realistic problem formulation, maybe in future “Battle” editions, could also include remote control of pumps and, also, variable speed pumps.

Depending on the particular strategy adopted, the solutions presented different trade-offs between capital (parallel pumps, tank enlargement, pipe renewal/doubling) and operational (energy, water losses) costs. The solutions showing lower capital costs, are also those requiring the highest operational costs. In fact, keeping the existing water infrastructures intact (i.e. without any investment on asset renewal) is likely to result in large volume of water losses and pumping energy requirements. On the other hand, a significant reduction in water losses can be achieved by strategically investing in renewal of pipes,

enlargement of tanks and/or new pumps. Some of the solutions with the lowest capital costs are also those requiring implementation of the largest number of PRVs to control as much as possible pressure through the network. Nonetheless, the need for providing water to customers that satisfies the minimum pressure requirement, does not permit further reduction of leakages via PRVs only.

Such a variety of solutions further demonstrates the need for engineering judgment as well as the knowledge of water utilities' management strategies to take effective and sustainable decisions in such a complex multi-objective problem encountered in a real networks.

## **Conclusions**

The Battle of Background Leakage Assessment for Water Networks (BBLAWN) was designed to follow the tradition of the “battle” competitions” held during the Water Distribution Systems Analysis (WDSA) Conferences. The BBLAWN problem was about the optimal management of water and energy resources, as relevant environmental and socio-economic issue worldwide. The competition considered asset renewal planning and strengthening, as well as optimal operation, including possible installation of PRVs. All the participant teams performed well in the competition, producing interesting results and some innovative ideas worthy of future exploration. Most of the proposed methodologies were able to suggest sensible solutions in both short time (operational) and medium time (tactical) horizons.

The review of all contributions clearly shows that conventional engineering expertise on its own is not sufficient to solve such a complex problem involving real size networks, where multiple conflicting objectives need to be considered and realistic technical constraints accounted for. Management decisions can and should be supported by tools that combine hydraulic models capable of assessing pressure-dependent background leakages with computationally effective multi-objective optimization strategies. In order to promote the discussion inside the technical/scientific community, the rules BBLAWN did not compel the use of any specific software for hydraulic modeling and only provided the management objectives to be fulfilled.

Due to the number of decision variables and the size of the search space, the WDN design process cannot be fully automated. Engineering judgment can and should provide invaluable support to the formal optimization approaches in the search for feasible alternative solutions. A multi-step approach was preferred by most of the teams since it permits the progressive evaluation of the improvements in WDN performance achievable at each step. The overview of proposed solutions demonstrated that many

alternatives are compatible with the problem in hand, ranging from massive network renewal (at lower operational cost) to minimal interventions (requiring high cost for energy and pumping). If the same approach was adopted for real life applications, the selection of the optimal strategy and of the most effective solution, should take into account the possibility of planning different interventions over time, thus reflecting the budget available. This would make preferable, for example, in the short term horizon the optimal control of pumps rather than more expensive renewal of asset.

The overview of the proposed strategies also emphasized the need to overcome current limitations of WDN simulation models in order to permit more realistic assessment of background leakages as well as the modelling of remotely controlled devices. This would permit more reliable simulations to support WDN management, allowing also the assessment of the impact of effective ICT solution for WDN operation.

### **Acknowledgements**

The organizers thank all the participants who contributed to the success of the competition: M. Morley, C. Tricarico, E. Roshani, Y. Fillion, P.L. Iglesias-Rey, F. J. Martínez-Solano, D. Mora Meliá, P.D. Martínez-Solano, E. Creaco, S. Alvisi, M. Franchini, E. Price, A. Ostfeld, K. Diao, M. Guidolin, G. Fu, R. Farmani, D. Butler, B.J. Eck, E. Arandia, J. Naoum-Sawaya, F. Wirth, B.A. Tolson, A. Khedr, J. Saldarriaga, D. Páez, J. Bohórquez, N. Páez, J.P. París, D. Rincón, C. Salcedo, D. Vallejo, J.P. Matos, A.J. Monteiro, N. Matias, A.J. Schleiss, F. Rahmani, K. Behzadian, J. Sousa, J. Muranho, A. Sá Marques, R. Gomes, A. Vassiljev, T. Koppel, R. Puust, M.E. Shafiee, A. Berglund, E. Zechman Berglund, E. D. Brill Jr., G. Mahinthakumar.

The research reported in this paper was founded by two projects of the Italian Scientific Research Program of National Interest PRIN-2012: “Tools and procedure for advanced and sustainable management of water distribution networks” and “Analysis tools for management of water losses in urban aqueducts”.

### **References**

- Battle of Background Leakage Assessment for Water Networks (BBLAWN) webpage:  
<http://www.water-system.org/wdsa2014/index155a.html?q=content/battle-water-networks>.
- Creaco, E., Alvisi, S., Franchini, M. (2014) “A Multi-Step Approach for Optimal Design and Management of the C-Town Pipe Network Model”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCDIA

- ENGINEERING, vol. 89, pp. 37-44, (doi: 10.1016/j.proeng.2014.11.157).
- Deb, K., Pratap, A., Agarwal, S., Meyarivan, T., (2002) “A fast and elitist multiobjective genetic algorithm: NSGA-II”, IEEE Transactions on Evolutionary Computation, 6(2), 182-197.
- Diao, K., Guidolin, M., Fu, G., Farmani, R., Butler, D. (2014) “Hierarchical Decomposition of Water Distribution Systems for Background Leakage Assessment”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 53-58, (doi: 10.1016/j.proeng.2014.11.159).
- Eck, B.J., Arandia, E., Naoum-Sawaya, J., Wirth, F. (2014) “A Simulation-Optimization Approach for Reducing Background Leakage in Water Systems”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 59-68, (doi: 10.1016/j.proeng.2014.11.160).
- Germanopoulos G., (1985) “A technical note on the inclusion of pressure dependent demand and leakage terms in water supply network models”, Civil Eng. Syst., 2, 171–179.
- Giustolisi O., L. Berardi, D. Laucelli, D. Savic, T. Walski, B. Brunone (2014) “Battle of Background Leakage Assessment for Water Networks (BBLAWN) at WDSA Conference 2014”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 4-12, (doi: 10.1016/j.proeng.2014.11.153).
- Giustolisi, O., Savic, D.A., Kapelan, Z., (2008). “Pressure-Driven Demand and Leakage Simulation for Water Distribution Networks.” Journal of Hydraulic Engineering, ASCE, USA, 134(5), 626 – 635.
- Giustolisi, O., Laucelli, D., Berardi, L. (2013). “Operational optimization: water losses vs. energy costs.” Journal of Hydraulic Engineering, ASCE, USA, 139(4), 410–423.
- Giustolisi O., Todini E., (2009) “Pipe hydraulic resistance correction in WDN analysis”, Special Issue on WDS Model Calibration, Urban Water Journal, 6, 39 – 52.
- Giustolisi, O., Walski, T.M., (2012). “A Demand Components in Water Distribution Network Analysis.” Journal of Water Resource Planning and Management, ASCE, USA, 138(4), 356 – 367.
- Giustolisi O, Berardi L, Laucelli D (2014). “Supporting Decision on Energy vs. Asset Cost Optimization in Drinking Water Distribution Networks.” In: 12th International Conference on Computing and Control for the Water Industry, CCWI2013. PROCEEDIA ENGINEERING, vol. 70, p. 734-743, ISSN: 1877-7058, Perugia, 2-4 September 2013.
- Iglesias-Rey, P.L., Martínez-Solano, F.J., Mora Meliá, D., Martínez-Solano, P.D., (2014) “BBLAWN: a Combined Use of Best Management Practices and an Optimization Model Based on a Pseudo-Genetic Algorithm”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014.

- Bari, Italy, 14-17 July 2014, *PROCEDIA ENGINEERING*, vol. 89, pp. 29-36, (doi: 10.1016/j.proeng.2014.11.156).
- Marchi, A., Salomons, E., Ostfeld, A., Kapelan, Z., Simpson, A., Zecchin, A., Maier, H., Wu, Z., Elsayed, S., Song, Y., Walski, T., Stokes, C., Wu, W., Dandy, G., Alvisi, S., Creaco, E., Franchini, M., Saldarriaga, J., Páez, D., Hernández, D., Bohórquez, J., Bent, R., Coffrin, C., Judi, D., McPherson, T., van Hentenryck, P., Matos, J., Monteiro, A., Matias, N., Yoo, D., Lee, H., Kim, J., Iglesias-Rey, P., Martínez-Solano, F., Mora-Meliá, D., Ribelles-Aguilar, J., Guidolin, M., Fu, G., Reed, P., Wang, Q., Liu, H., McClymont, K., Johns, M., Keedwell, E., Kandiah, V., Jasper, M., Drake, K., Shafiee, E., Barandouzi, M., Berglund, A., Brill, D., Mahinthakumar, G., Ranjithan, R., Zechman, E., Morley, M., Tricarico, C., de Marinis, G., Tolson, B., Khedr, A., and Asadzadeh, M. (2014). "Battle of the Water Networks II." *J. Water Resour. Plann. Manage.*, 140(7), 04014009.
- Matos, J.P., Monteiro, A.J., Matias, N., Schleiss, A.J. (2014) "Guided Evolutionary Approaches for Redesigning Water Distribution Networks", In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, *PROCEDIA ENGINEERING*, vol. 89, pp. 87-94, (doi: 10.1016/j.proeng.2014.11.163).
- Morley, M.S., Tricarico, C. (2014) "A Comparison of Population-based Optimization Techniques for Water Distribution System Expansion and Operation", In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, *PROCEDIA ENGINEERING*, vol. 89, pp. 13-20, (doi: 10.1016/j.proeng.2014.11.154).
- Ostfeld A, Salomons E, Ormsbee L, Uber J G, Bros C M, Kalungi P, Burd R, Zazula-Coetzee B, Belrain T, Kang D, Lansley K, Shen H, Mcbean E, Wu Z Y, Walski T, Alvisi S, Franchini M, Johnson J P, Ghimire S R, Barkdoll B D, Koppel T, Vassiljev A, Kim J H, Chung G, Yoo D G, Diao K, Zhou Y, Li J, Liu Z, Chang K, Gao J, Qu S, Yuan Y, Prasad T D, Laucelli D, Vamvakeridou Lyroudia L S, Kapelan Z, Savic D, Berardi L, Barbaro G, Giustolisi O, Asadzadeh M, Tolson B A, Mckillop R., (2012) "The Battle of the Water Calibration Networks (BWCN)", *J. Water Res. Plan. and Manage.*, 138 (5) 523–532.
- Ostfeld, A., Uber, J., Salomons, E., Berry, J., Hart, W., Phillips, C., Watson, J., Dorini, G., Jonkergouw, P., Kapelan, Z., di Pierro, F., Khu, S., Savic, D., Eliades, D., Polycarpou, M., Ghimire, S., Barkdoll, B., Gueli, R., Huang, J., McBean, E., James, W., Krause, A., Leskovec, J., Isovitsch, S., Xu, J., Guestrin, C., VanBriesen, J., Small, M., Fischbeck, P., Preis, A., Propato, M., Piller, O., Trachtman, G., Wu, Z., and Walski, T. (2008). "The Battle of the Water Sensor Networks: A design challenge for engineers and algorithms." *J. Water Resour. Plann. Manage.*, 134(6), 556–568.

- Price, E., Ostfeld, A. (2014) “Battle of Background Leakage Assessment for Water Networks Using Successive Linear Programming”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 45-52, (doi: 10.1016/j.proeng.2014.11.158).
- Rahmani, F., Behzadian, K., Ardeshir A. (2014) “Sequential Multi-Objective Evolutionary Algorithm for a Real-World Water Distribution System Design”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 95-102, (doi: 10.1016/j.proeng.2014.11.164).
- Roshani E., Filion, Y. (2014) “WDS Leakage Management through Pressure Control and Pipes Rehabilitation Using an Optimization Approach”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 21-28, (doi: 10.1016/j.proeng.2014.11.155).
- Rossman, L. A., (2000) “EPANET2 user’s manual”, U.S. EPA, Washington, DC.
- Saldarriaga, J., Páez, D., Bohórquez, J., Páez, N., París, J.P., Rincón, D., Salcedo, C., Vallejo, D. (2014) “An Energy Based Methodology Applied to C-Town”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 78-86, (doi: 10.1016/j.proeng.2014.11.162).
- Shafiee, M.E., Berglund, A., Zechman Berglund, E., Downey Brill Jr., E., Mahinthakumara, G. (2014) “Evolutionary Computation-Based Decision-Making Framework for Designing Water Networks to Minimize Background Leakage”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 118-125, (doi: 10.1016/j.proeng.2014.11.162).
- Sousa, J., Muranho, J. Sá Marques, A., Gomes, R. (2014) “WaterNetGen HELPS C-Town”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 103-110, (doi: 10.1016/j.proeng.2014.11.165).
- Tolson, B.A., Khedr, A. (2014) “Battle of Background Leakage Assessment for Water Networks (BBLAWN): an Incremental Savings Approach”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 69-77, (doi: 10.1016/j.proeng.2014.11.161).
- Vassiljev, A., T. Koppel, Puust, R. (2014) “Background Leakage Assessment for BBLAWN”, In: 16th International Conference on Water Distribution Systems Analysis, WDSA2014. Bari, Italy, 14-17 July 2014, PROCEEDIA ENGINEERING, vol. 89, pp. 111-117, (doi: 10.1016/j.proeng.2014.11.166).



Walski, T., Brill, E., Jr., Gessler, J., Goulter, I., Jeppson, R., Lansey, K., Lee, H., Liebman, J., Mays, L., Morgan, D., and Ormsbee, L. (1987). "Battle of the network models: Epilogue." *J. Water Resour. Plann. Manage.*, 113(2), 191–203.